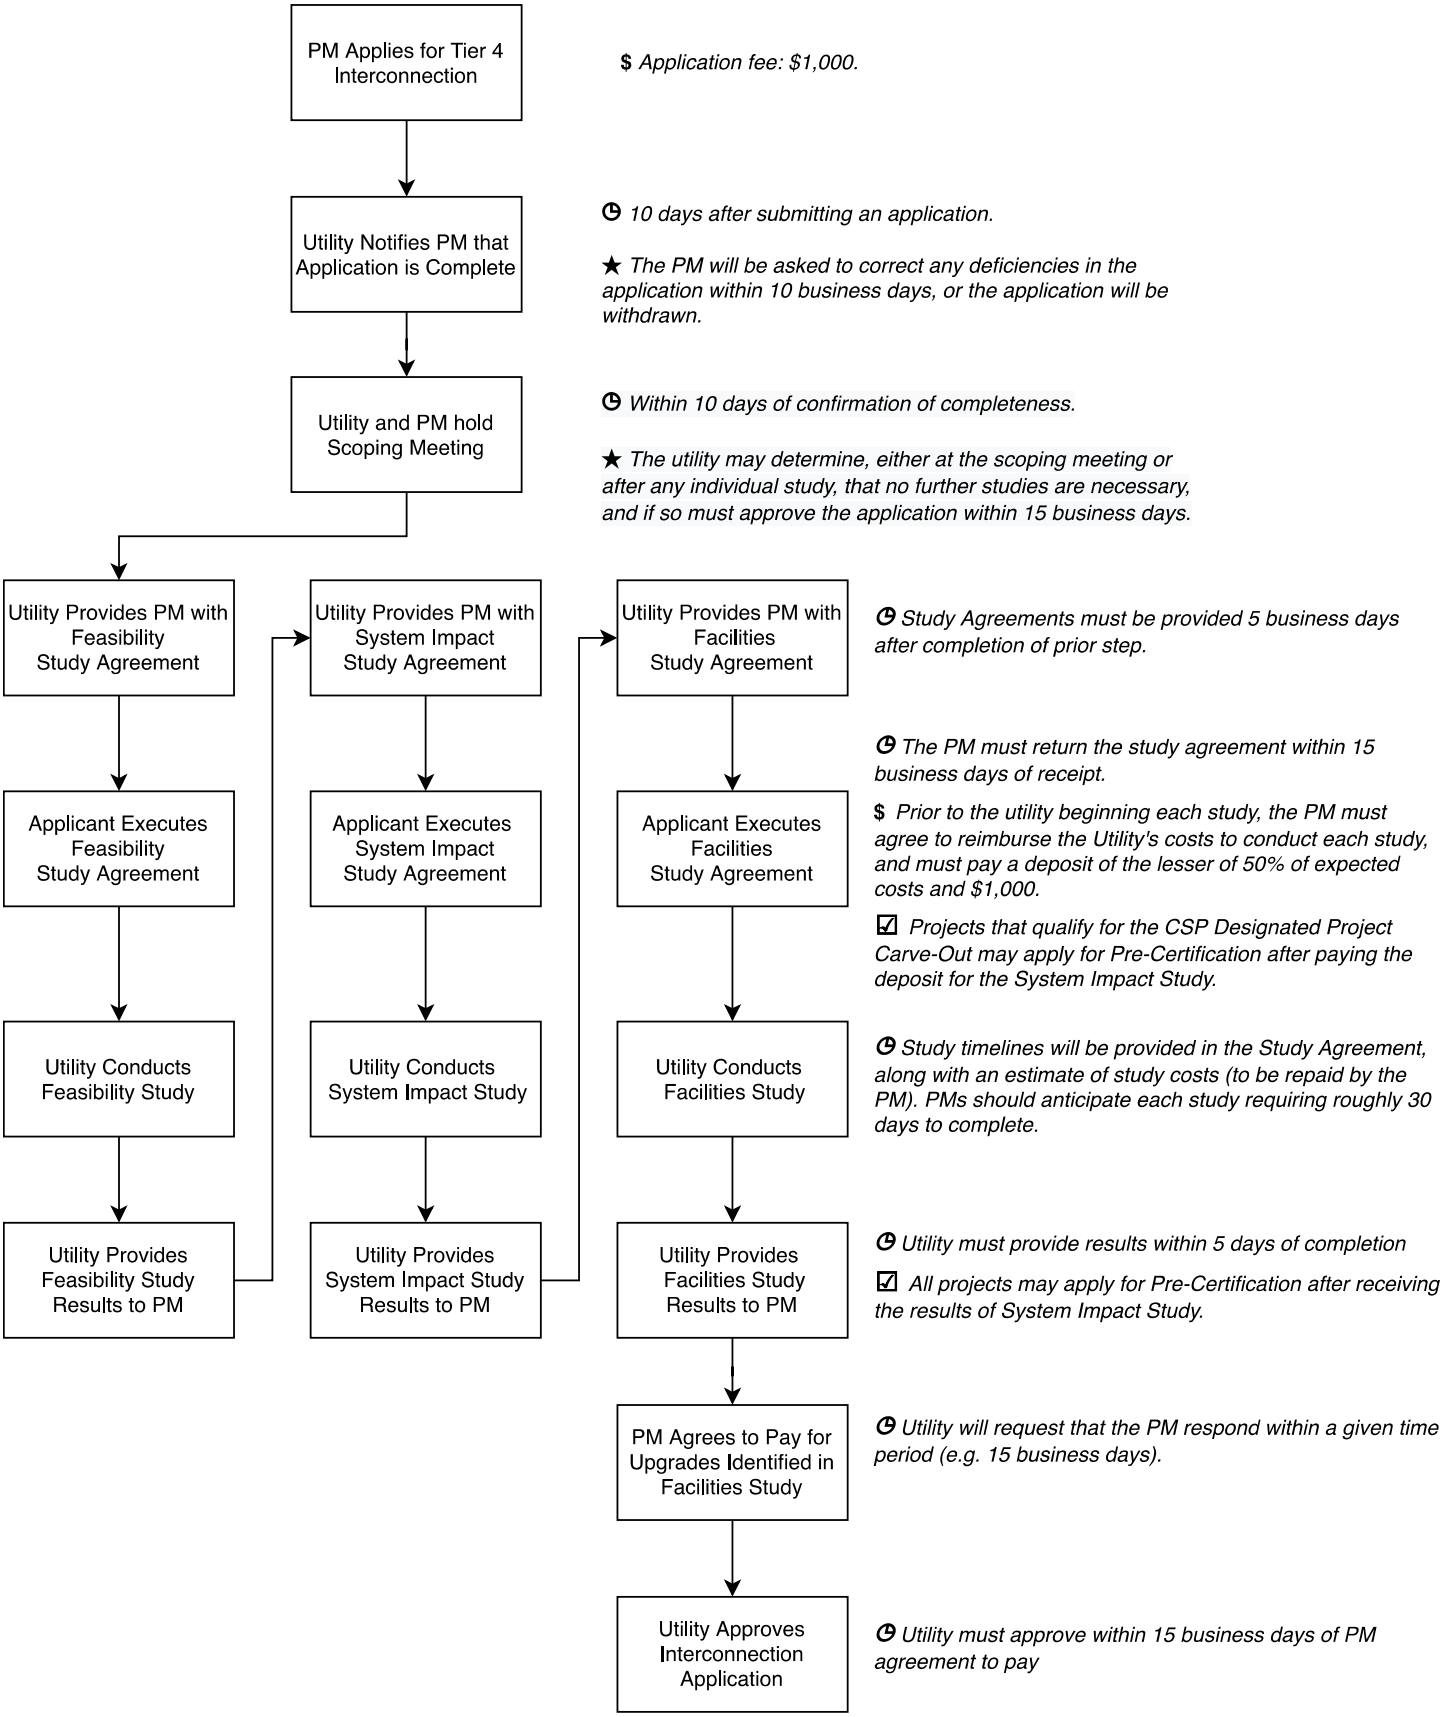TIER 4 INTERCONNECTION REVIEW PROCESS